


**NOTE:**

1. BEFORE APPLICATION OF UNITED COATINGS™ PMMA FLASHING MEMBRANE, FLEXSEAL CAULK GRADE SEALANT SHOULD BE USED TO FILL VOIDS WHERE ROOFING MEMBRANES TERMINATE AT PENETRATIONS.
2. REFER TO GAF PREPARATION GUIDELINES FOR PROPER SURFACE TREATMENT OF ALL MATERIALS PRIOR TO APPLICATION OF UNITED COATINGS™ PMMA FLASHING SYSTEM.
3. A NAILER AND TREATED WOOD CANT MAY BE REQUIRED FOR COMPLIANCE WITH SPECIFIC BUILDING CODES OR APPROVALS.
4. UNITED COATINGS™ PMMA CANNOT BE APPLIED IN THE ABOVE CONFIGURATION OVER MEMBRANES OR OTHER MATERIALS CONTAINING UNCURED, SOLVENT-BASED MATERIALS. CONTACT GAF FOR INFORMATION.
5. REFER TO GAF FLEECE CUTTING RECOMMENDATIONS FOR CONFIGURATIONS, CUTTING, FOLDING, AND LAPPING TECHNIQUES.
6. REQUIREMENTS AND RECOMMENDATIONS DETAILED IN CURRENT GAF SPECIFICATIONS AND THE UNITED COATINGS™ PMMA FLASHING SYSTEM INSTALLER'S GUIDE SHALL APPLY IN ADDITION TO THE DRAWING BELOW.
7. DO NOT USE OVER COLD-APPLIED OR APP SYSTEMS.

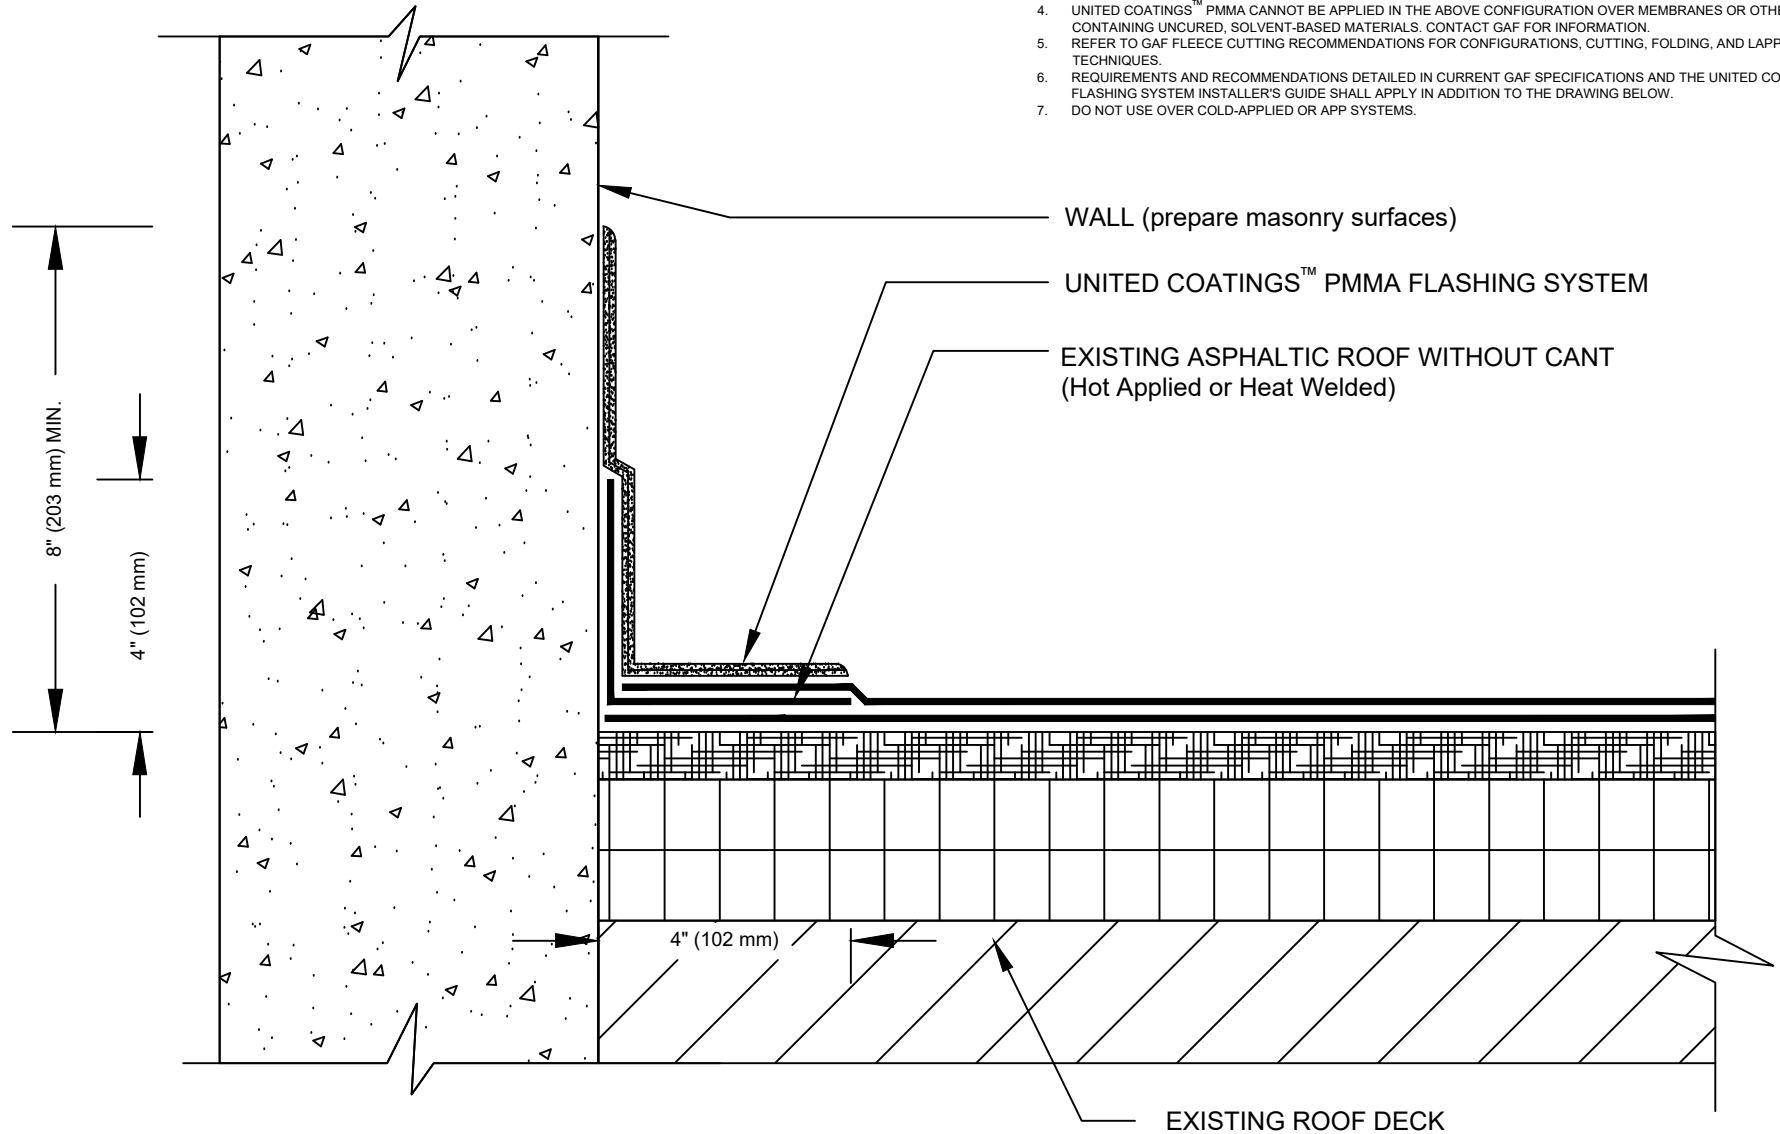


EXISTING LOW WALL FLASHING W/ SELF-TERMINATING PMMA FLASHING DETAIL

DRAWING #  
**301**

ISSUE / REVISION DATE  
2/20/20

SCALE  
N.T.S.

LEGEND	
	UNITED COATINGS™ PMMA FLASHING SYSTEM